

HFC-227EA INSTRUCTIONAL SIGNS

DESCRIPTION

Instructional signs are used to provide the necessary information to personnel in the area and to comply with NFPA 2001 requirements. The caution lettering and backgrounds meet the requirements of ANSI Z535. The signs are made from flame retardant, Lexan™ polycarbonate material. Each sign has an adhesive backing mounting purposes. These signs are an optional item and must be ordered separately.

APPROVALS:

- UL Listed
- ULC Listed
- FM Approved



LISTED



CAUTION – AREA PROTECTED BY HFC-227ea SIGN (P/N 02-10139)

Provided to alert personnel that the room is protected with an HFC-227ea system and that they should not enter the area during or after discharge.

The sign also indicates the requirement that all doors serving the protected area must be kept closed at all times.

The sign is 13.0" (330 mm) x 10.0" (254 mm), with black lettering on a yellow background for Caution and black lettering on a white background for Sign text.



CAUTION – SYSTEM DISCHARGE ALARM SIGN (P/N 02-10138)

Provided to alert personnel that the room is protected with an HFC-227ea system and to evacuate the area when the alarms sound.

This sign is provided to alert personnel that the room is protected with an HFC-227ea system and that they should not enter the area when the alarm sounds.

The sign is 9.0" (229 mm) x 6.0" (154 mm), with black lettering on a yellow background for Caution and black lettering on a white background for Sign text.



CAUTION - EXIT AREA (P/N 02-10105)

Provided to explain the presence of notification devices that are located inside the protected space.

This sign explains that the HFC-227ea system will soon be discharged if the strobe light is flashing, and appropriate actions should be taken. This sign should be placed at each strobe light location.

The sign is 9.0" (229 mm) x 6.0" (154 mm), with black lettering on a yellow background for Caution and black lettering on a white background for Sign text.




SYSTEM RELEASE SIGN (P/N 02-10137)

Provided to identify each system release station associated with the HFC-227ea system.

This reduces the risk of a manual discharge station being mistaken for a fire alarm pull station.

This sign should be placed at each manual release station location for positive identification. This sign is 4.0" (102 mm) x 2.25" (57 mm), with red lettering on a white background.

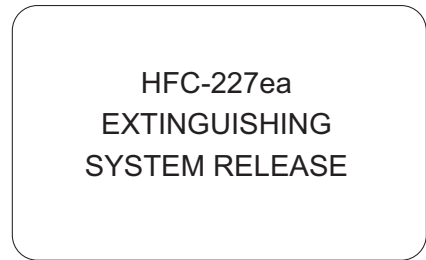


MAIN / RESERVE SIGN (P/N 02-10107)

Provided to identify each system main/reserve station associated with the HFC-227ea system.

This sign clearly identifies the purpose of the switch.

This sign should be placed at each main/reserve station location for positive identification.

This sign is 4.0" (102 mm) x 2.25" (57 mm), with white lettering on a red background.

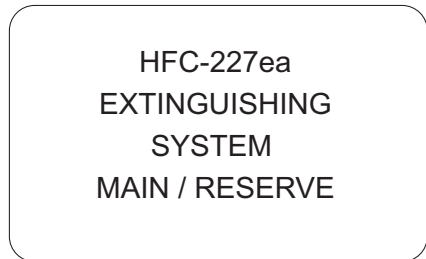

SYSTEM ABORT SIGN (P/N 02-10106)

Provided to identify each system abort station associated with the HFC-227ea system.

This reduces the risk of an abort station being mistaken for a manual release or fire alarm pull station.

This sign should be placed at each abort station location for positive identification.

The sign is 4.0" (102 mm) x 2.25" (57 mm), with red lettering on a white background.

