


HFC-227ea INSTRUCTIONAL SIGNS

DESCRIPTION

Instructional signs must be supplied in order to provide a system in which the function of all devices is easy to understand. Fike offers several different "Standard" signs to comply with N.F.P.A. and other industry requirements. The following signs are applicable and utilized in the United Kingdom market.


CAUTION SIGN - P/N 02-4694

The purpose of this sign is to alert personnel that the room is protected with an FPS/HFC-227ea Clean Agent System and to evacuate the area when the alarms sound. The sign measures 210mm x 210mm. The caution sign should be placed on the outside of every door entering/exiting the protected space.

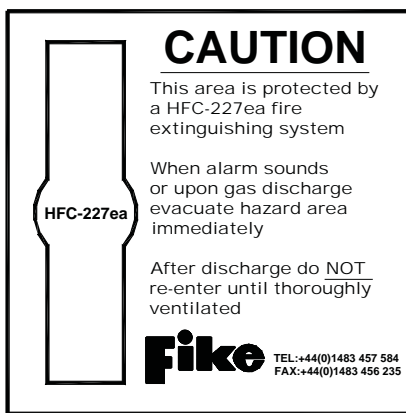

MANUAL DISCHARGE STATION - P/N 02-4695

The manual discharge station sign will identify each manual release associated with the HFC-227ea Clean Agent System. This reduces the risk of a manual discharge station being mistaken for a fire alarm system station. The sign measures 210mm x 75mm. The manual discharge sign should be located at each system manual release station for quick, positive identification.

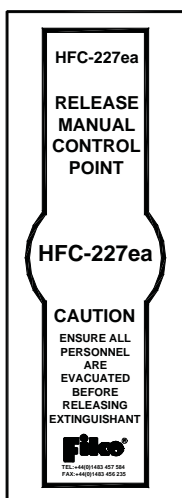

(This page is left blank intentionally)

